


ITEM	QTY	DESCRIPTION	MATERIAL
1	1	BODY КОРПУС	ASTM A105 / SA105N
2	1	BONNET КОЛПАЧОК	ASTM A105 / SA105N
3	2	DISC ДИСК	13Cr / STELLITED
4	2	SEAT СЕДЛО	13Cr / STELLITED
5	1	STEM ШТОК	A276 410
6	1	DISC HOLDER ДЕРЖАТЕЛЬ ДИСКА	A351 CF3M
7	SET	BELLEVILLES SPRING ПРУЖИНЫ ДИСКА	INCONEL 718
8	1	PIN ШПИЛЬКА	A276 316
12	1	PACKING НАБИВКА ШТОКА	GRAPHITE
13	1	GLAND САЛЬНИК	A276 304
14	1	GLAND FLANGE ФЛАНЕЦ САЛЬНИКА	A105
15	2	GLAND BOLT БОЛТ САЛЬНИКА	A193 B7
16	2	GLAND NUT ГАЙКА САЛЬНИКА	A194 2H
17	2	GASKET ПРОКЛАДКА	GRAPHITE
20	1	GUIDE FLANGE НАПРАВЛЯЮЩАЯ ФЛАНЕЦ	A276 410
21	1	LOCK NUT ГАЙКА	A276 304
22	4	BOLT БОЛТ	A193 B8
23	4	YOKE BAR РАСПОРНЫХ ВТУЛОК	CARBON STEEL
24	1	GUIDE НАПРАВЛЯЮЩАЯ	CARBON STEEL
25	1	NUT ГАЙКА	CARBON STEEL
26	1	YOKE FLANGE ФЛАНЕЦ ХОМУТА	CARBON STEEL
27	1	BOLT БОЛТ	A193 B7
28	1	ELECTRIC ACTUATOR ЭЛЕКТРИЧЕСКИМ ПРИВОДОМ	MAKE: LIMITORQUE TYPE: MX05-A

MAIN DIMENSIONS IN MM.					
ITEM NR.	NOM. SIZE	H	L	P	WEIGHT
170	40MM	245	130	20	30 KG.

MAIN DIMENSIONS IN INCHES					
NOM. SIZE	H	L	P	WEIGHT	
1-1/2"	9.6	5.11	0.79	66.1 LBS	

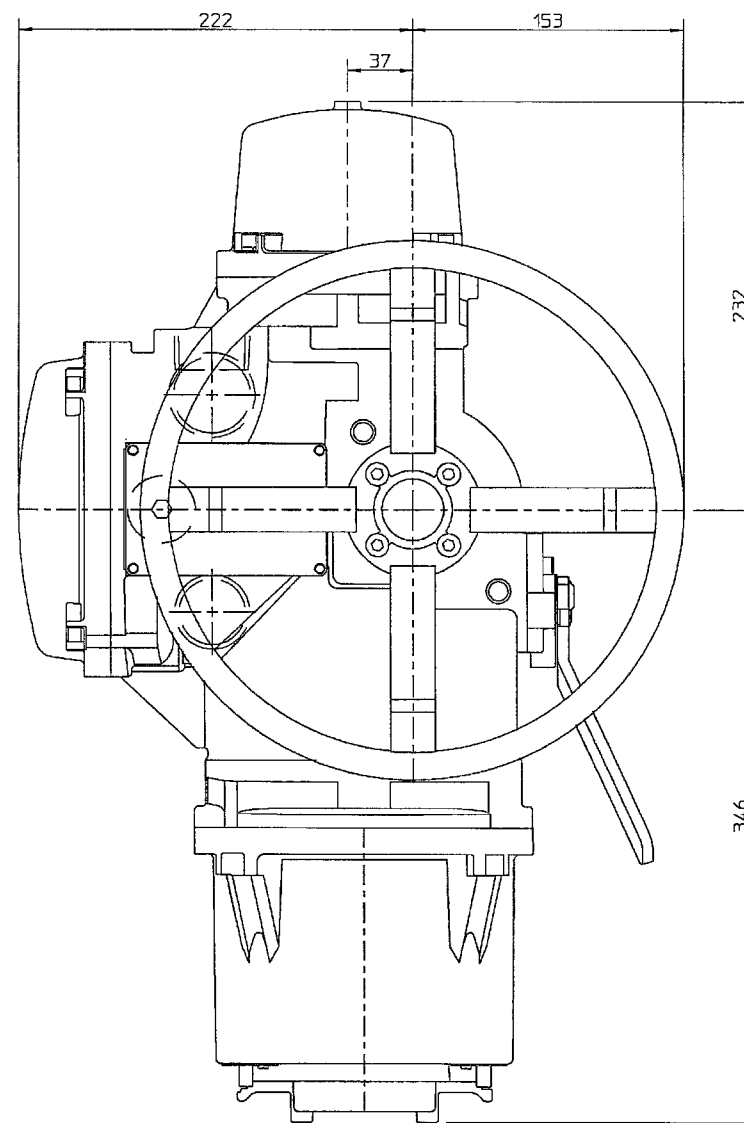

ACTUATOR TOPVIEW

HP VALVES REF. : 20100006		P.O. Box 151
APPROVAL : <i>pk</i>		7570 AD Oudenzaal
PROJECT REFERENCE: YAJVINSKAYA CCPP		The Netherlands
CLIENT P/O NO : 203/2010/900588		Tel +31 (0)541 519555
CLIENT : CMI		www.hpvalves.com Info@hpvalves.com

REQ. NUMBER: 239170
DESIGN PRESS. DESIGN TEMP.
TAG NR. BAR (G) °C
15HAH10AA102 142 338.3

PRESSURE TESTING	ACC. ASME B16.34
VALVE DESIGN	ACC. ASME B16.34
END CONN.	SW SCHED.160 ACC. ASME B16.11
HP FIG. NR.	KJPX25AGBA
COATING SYSTEM	1 LAYER HEMPEL SILICONE ZINC 16900

A	04.02.2010	FIRST ISSUE.	R.T.B	R.K
IZH. REV.	DATA DATE	OPISANIE DESCRIPTION	NACERCEND DRN.	RAZR. STR.
			PROVER. CHK.	UTVER. APP.



ЧЕТВЕРТАЯ ГЕНЕРИРУЮЩАЯ КОМПАНИЯ  
ОПТОВОГО РЫНКА ЭЛЕКТРОЭНЕРГИИ

**ENKA**


Power Systems B.V.

'YVINSKA' GR\_S

**YAJVA STATE DISTRICT POWER PLANT**

TITLE : FORGED STEEL PARALLEL SLIDE GATE VALVE  
PRESSURE CLASS: 1500 LBS  
NOM SIZE: 1"

STATUS		REVISIONS	
PRELIMINARY			
FOR LAYOUT			
FOR CONSTRUCTION			
FOR CONSTRUCTION EXCEPT HOLD			
AS BUILT			
Destination		E/01/161031	
YAJVA STATE DISTRICT POWER PLANT		ORDER N°	
		Engineer	LEVAUX
		Checker	R.K
		Draftman	R. f. B
		Name	Signature

Designation		
HP DRUM FILLING VENT ISOLATION VALVE		
This drawing and the design it covers are the property of CMI. They are merely loaned on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited or used except in the limited way of and private use permitted by any written consent given by CMI to the borrower.	No Draw	66094/23170/2
		Scale